



PLAN VIEW

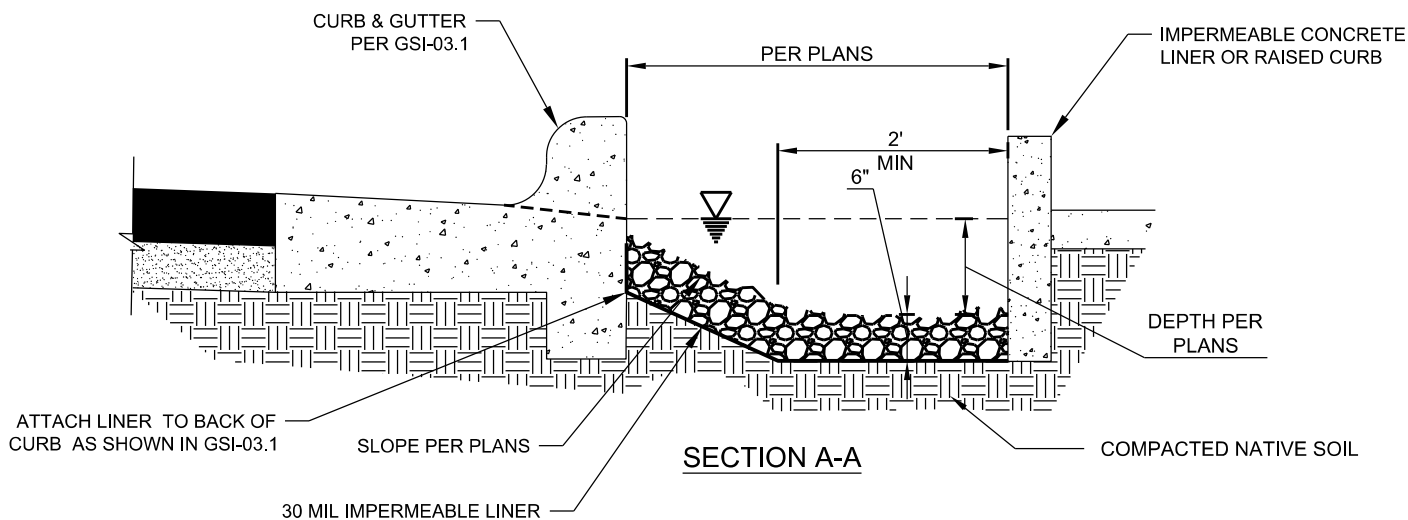

SECTION A-A

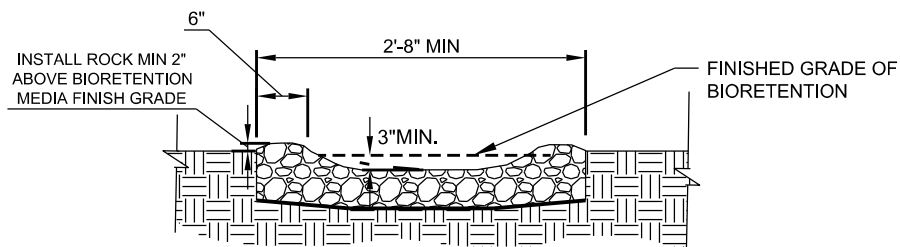

SECTION B-B

NOTES:

1. ENERGY DISSIPATION PAD PROVIDED AS STABILIZED ENTRANCE TO BIORETENTION SYSTEM. ROCK SHALL BE PLACED IN IRREGULAR PATTERN USING NON-UNIFORM SIZES TO PREVENT PREFERENTIAL FLOW PATHS, INCREASE ENERGY DISSIPATION, AND TO LIMIT THE SURFACE AREA OF EXPOSED MORTAR. ALTERNATIVE PRE-TREATMENT SOLUTIONS WILL BE CONSIDERED.
2. ROCK AND MORTAR INLET PROTECTION SHALL EXTEND ACROSS BOTTOM OF BIORETENTION TO OPPOSITE TOE OF SLOPE, OR 2' MINIMUM. FINISH GRADE OF MORTARED BOTTOM SHALL BE AT LEAST 3" BELOW ADJACENT BIORETENTION BOTTOM ELEVATION TO PROVIDE SEDIMENT STORAGE.

CITY OF RALEIGH		
STANDARD DETAIL		
REVISIONS	DATE: 08/2021	NOT TO SCALE
ENERGY DISSIPATION PAD		
GSI-12		