


COVER FOR PIPES WITHIN THE R.O.W. MINIMUM PIPE CLEARANCE FROM INVERT TO SUBGRADE	
PIPE SIZE (in)	CLEARANCE DISTANCE (ft)
15	2.4
18	2.7
24	3.3
30	3.6
36	4.4
42	4.9
48	5.4
54	6.0
60	6.5
66	7.0
72	7.6

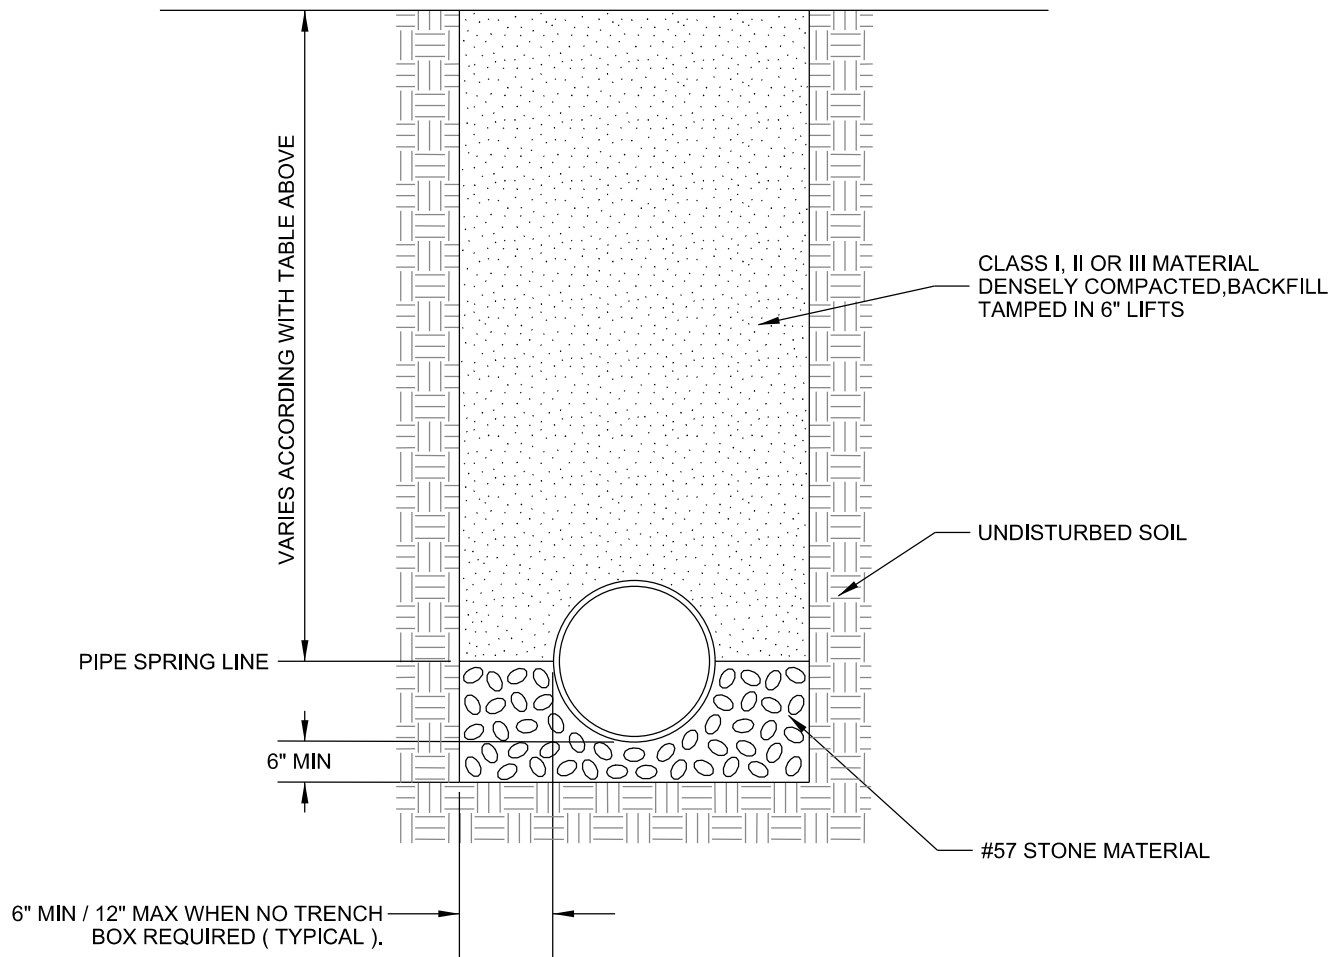

CITY OF RALEIGH STANDARD DETAIL		
REVISIONS	DATE: 8/2020	NOT TO SCALE
	BEDDING FOR STORMWATER RCP PIPES	
	SW-10.14	