


**PLAN W / INLET  
INLET PROTECTION - COR BOX**

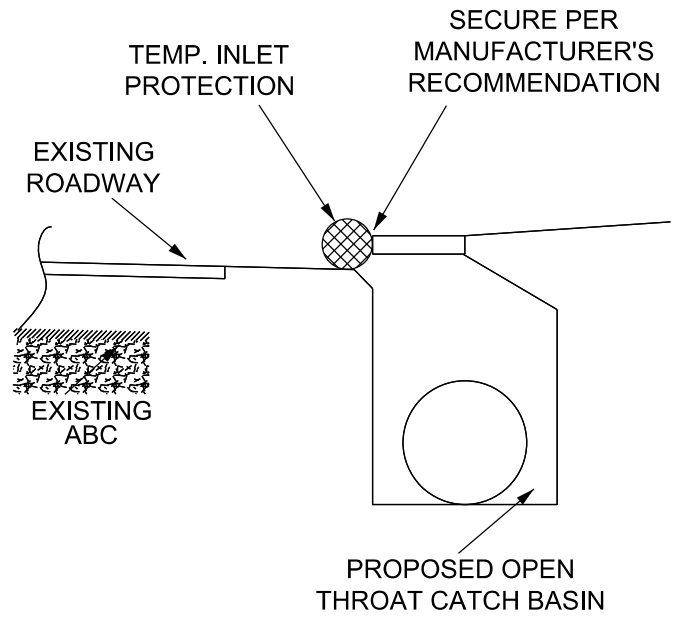

**CROSS SECTION**

**INSTALLATION NOTES:**

1. WATTLES SHALL BE FILLED WITH STRAW OR OTHER APPROVED MATERIAL.

**MAINTENANCE NOTES:**

1. MEASURES SHALL BE INSPECTED AT LEAST ONCE A WEEK OR IMMEDIATELY AFTER EACH RAINFALL OF 1.0 INCH OR GREATER. MAKE ANY REQUIRED REPAIRS IMMEDIATELY.
2. REMOVE ACCUMULATED SEDIMENT OR DEBRIS.
3. WATTLES MUST BE REPLACED IF CLOGGED OR TORN OR IF WATER DOES NOT APPEAR TO BE DRAINING THROUGH THE WATTLE.
4. REINSTALL IF DAMAGED OR DISLODGED. IF THE WATTLE FALLS INTO THE STORM DRAIN REMOVE IMMEDIATELY AND REINSTALL.
5. IF PONDING BECOMES EXCESSIVE, THE WATTLE MAY NEED TO BE REPLACED WITH A LARGER DIAMETER OR A DIFFERENT MEASURE.

<b>CITY OF RALEIGH</b>		
<b>STANDARD DETAIL</b>		
REVISIONS	DATE: 9/2024	NOT TO SCALE
	WATTLE / INLET PROTECTION DETAIL	
	<b>SW-20.20</b>	