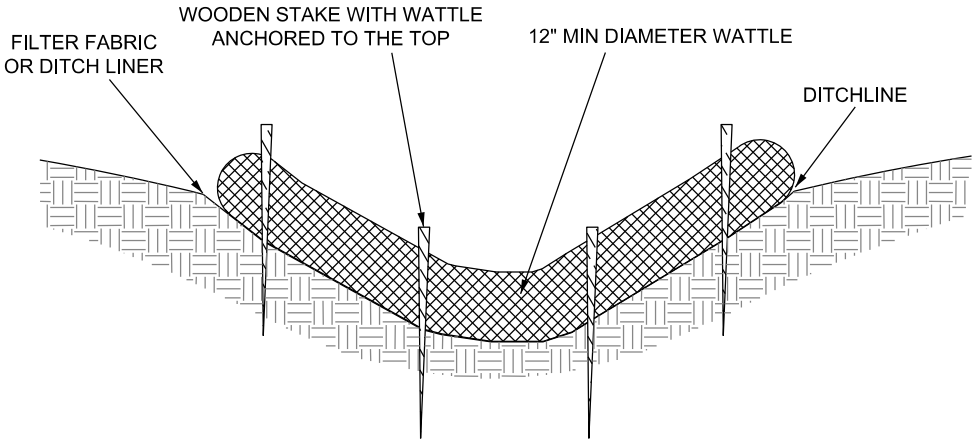

PROFILE VIEW

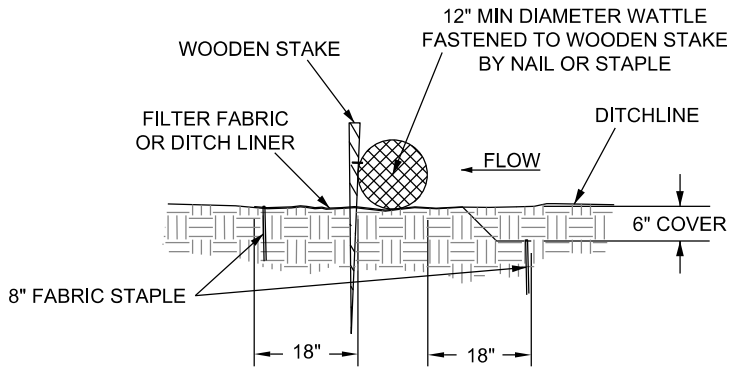

NOTES:

1. WATTLES SHALL BE FILLED WITH STRAW OR OTHER APPROVED MATERIAL.
2. SPACING FOR WATTLES SHALL BE DETERMINED BY THE SITE ENGINEER.
3. WATTLES MAY BE USED FOR PROTECTION OF CATCH BASINS AND DROP INLETS WITH APPROVAL BY THE STORMWATER PROGRAM MANAGER OR DESIGNEE.
4. FOR USE OF WATTLE IN A DITCH, GRADE OF DITCH MUST BE <2.5%.

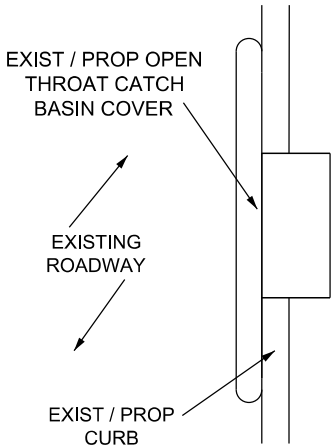

PLAN W / INLET
INLET PROTECTION - COR BOX

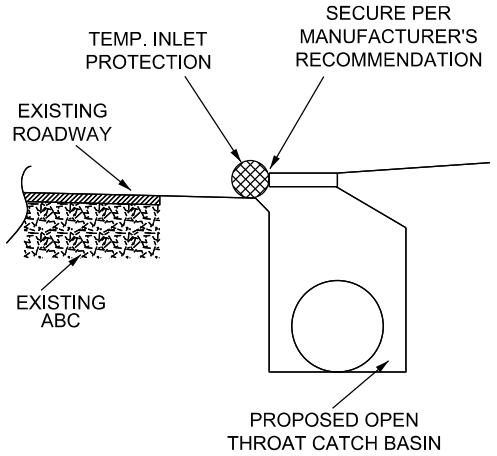

CROSS SECTION

CITY OF RALEIGH
STANDARD DETAIL

REVISIONS

DATE: 8/2020

NOT TO SCALE

WATTLE / INLET
PROTECTION DETAIL

SW-20.23