PAY LIMITS FOR CURB RAMP

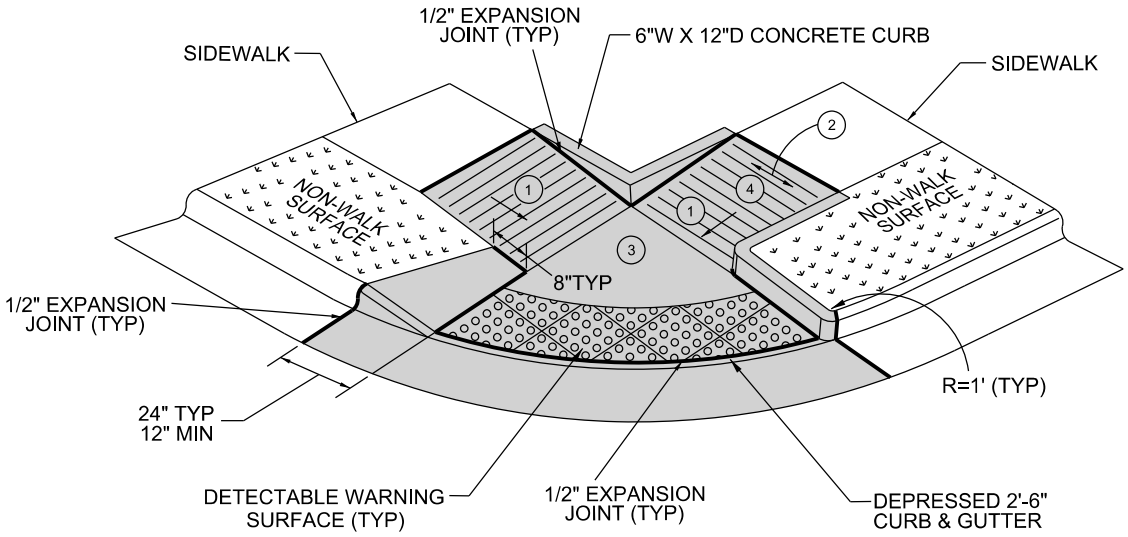

SMALL RADIUS
LESS THAN 15'

CONCRETE DEPTH	
SIDE RAMPS	4"
LANDING & CURB RAMPS	6"

1. 8.33% (12:1) MAX RAMP SLOPE
2. CROSS SLOPE: 2.00%
3. CURB RAMPS REQUIRE A (4'-0") MINIMUM LANDING WITH A MAXIMUM CROSS SLOPE AND LONGITUDINAL SLOPE OF 2.00% WHERE PEDESTRIANS PERFORM TURNING MANEUVERS. SLOPE TO DRAIN TO CURB.
4. RAMPS SHALL BE INSTALLED THE SAME WIDTH AS THE SIDEWALK.

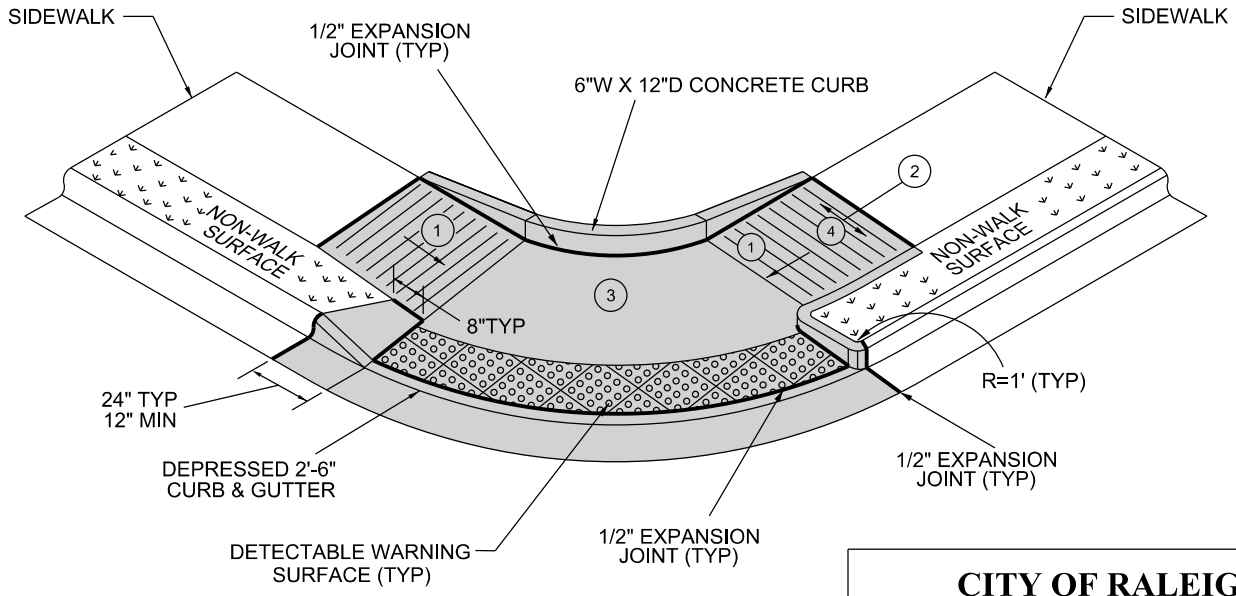

LARGER RADIUS
15' OR GREATER

ONLY TO BE USED WITH CITY OF RALEIGH APPROVAL.

CITY OF RALEIGH
STANDARD DETAIL

REVISIONS	DATE: 8/2020	NOT TO SCALE
	SHARED CURB RAMP/FLARE (RETROFIT)	
	T-20.01.7	