
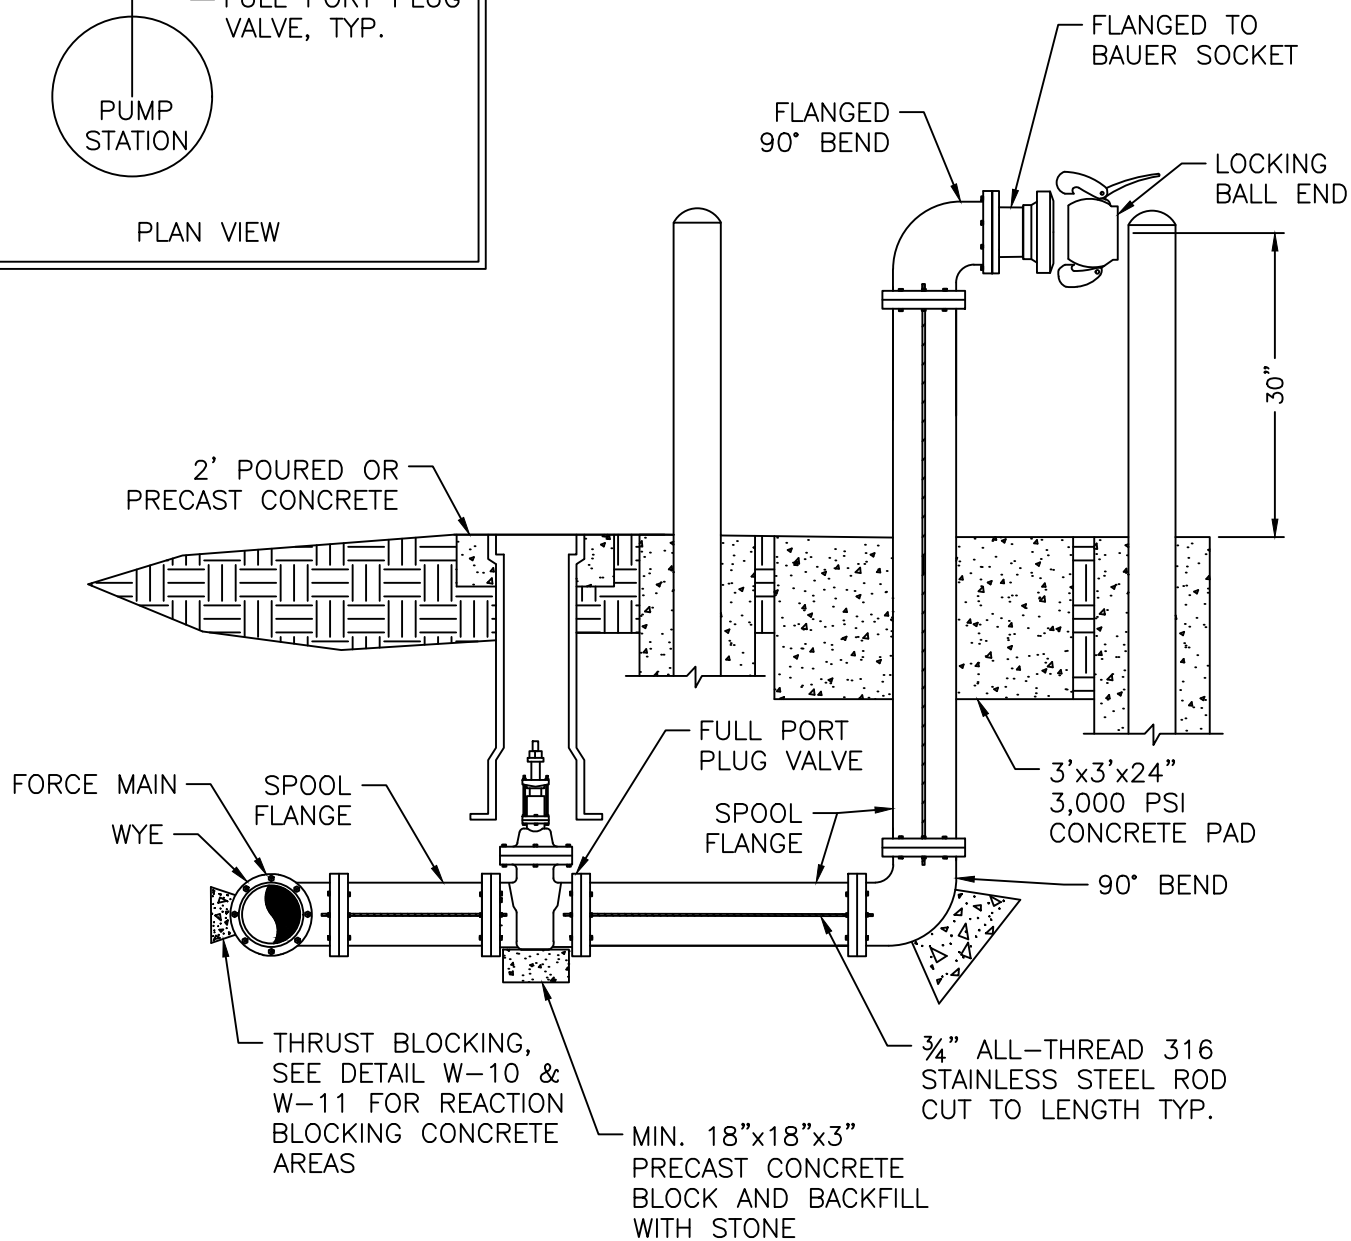


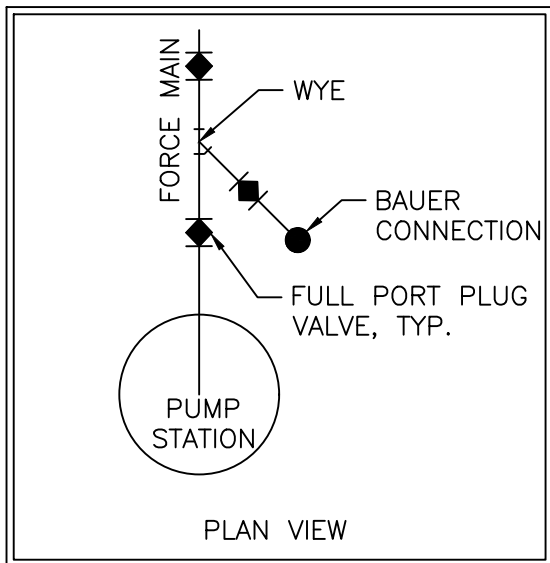

NOTES:

1. BYPASS DIAMETER SHALL MATCH FM DIAMETER UNLESS APPROVED BY RALEIGH WATER.
2. THE DESIGN ENGINEER SHALL LAYOUT BYPASS CONNECTION RISER TO PREVENT MAINTENANCE ACCESS CONFLICTS WITH THE PUMP STATION.

CITY OF RALEIGH
STANDARD DETAIL

REVISIONS	DATE: 01/18/2025	NOT TO SCALE
	BYPASS CONNECTION FOR PUMP STATIONS AND FORCE MAINS	
	S-55	