



PLAN VIEW

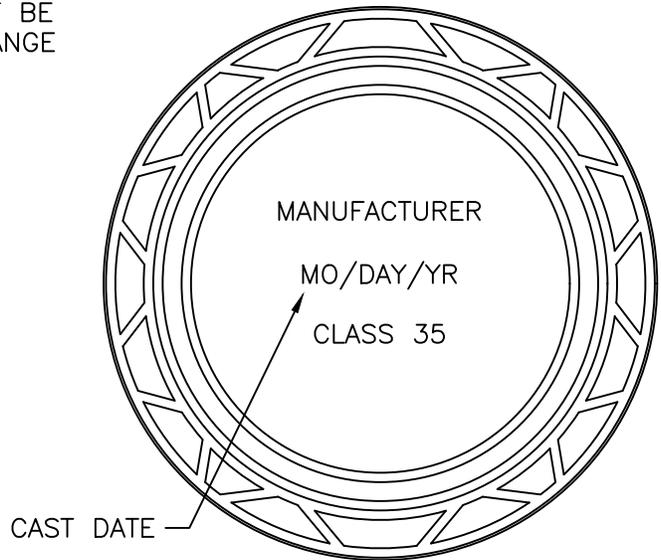

BOTTOM VIEW

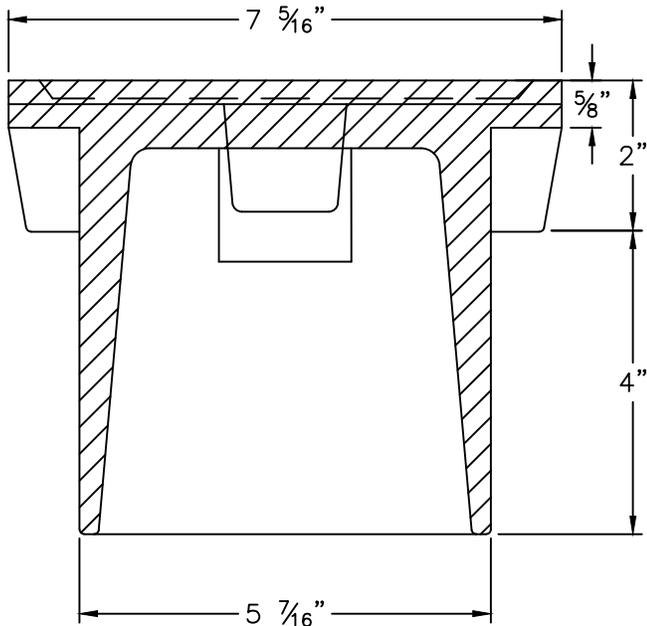

SECTION VIEW

NOTE:

1. "WATER" AND "REVERSE" LETTERING MUST BE 1" RAISED (RECESSED FLUSH).
2. VALVE COVER SHALL BE DOMESTICALLY CAST.
3. COVER MUST HAVE A MINIMUM WEIGHT OF 25 POUNDS.
4. COVER MUST BE CLASS 35 OR GREATER.
5. COVER MUST MEET OR EXCEED AASHTO H-20 LOAD REQUIREMENTS.

**CITY OF RALEIGH**  
**STANDARD DETAIL**

REVISIONS      DATE: 01/18/2025      NOT TO SCALE

REVERSE TAP 5 1/4"  
VALVE BOX DROP LID  
WITH 4" SKIRT

**W-18A**